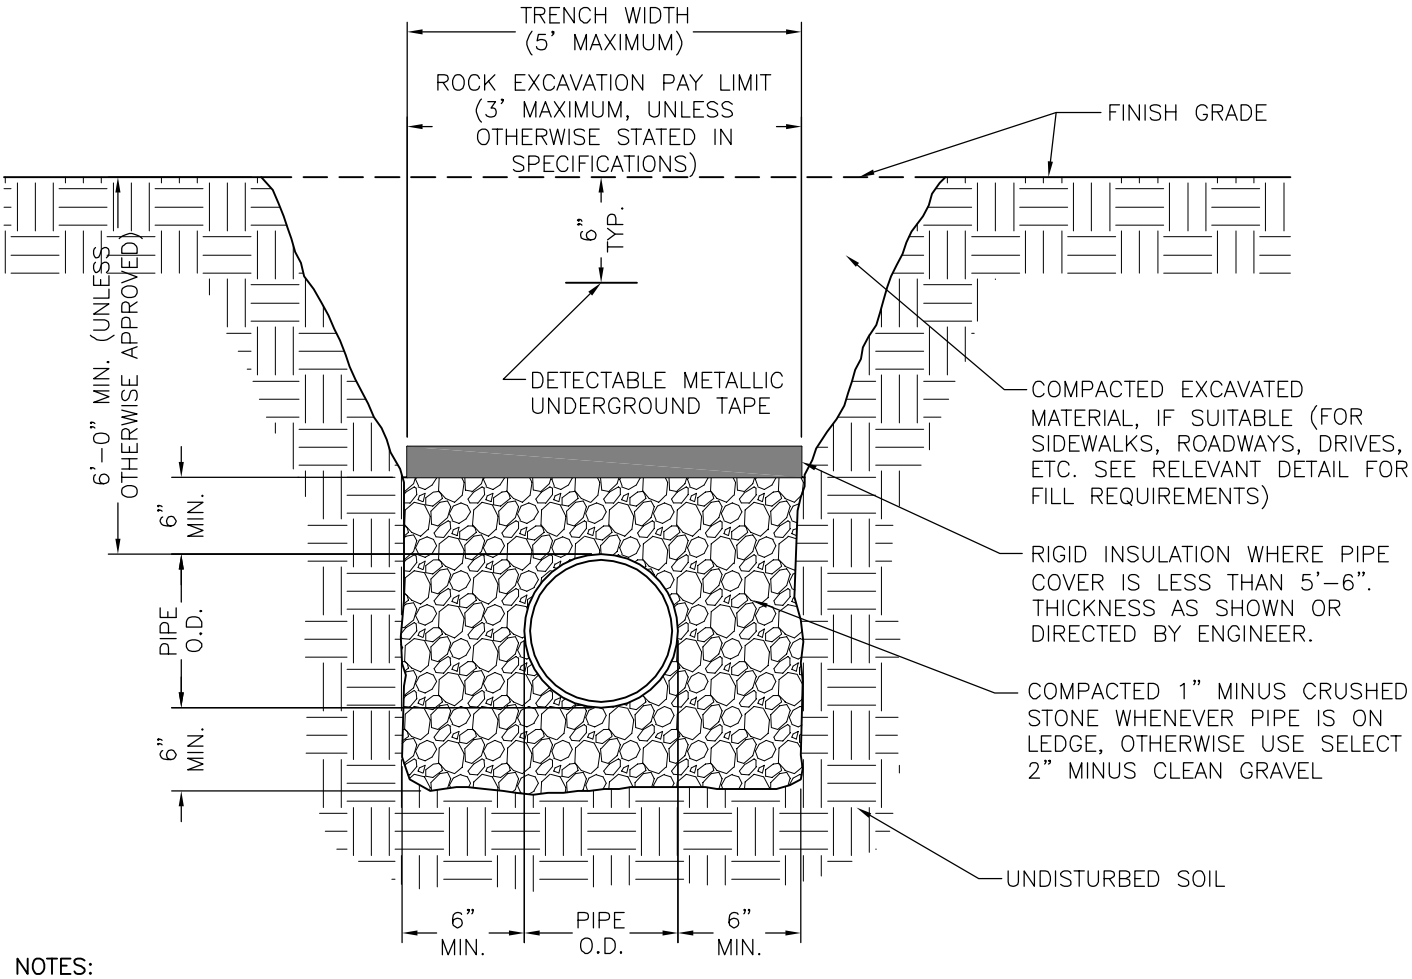


NOTES:

1. MAINTAIN UNIFORM TRENCH WIDTH TO 6" MINIMUM OVER PIPE.
2. SEE PAVEMENT DETAILS FOR PAVING REQUIREMENTS IN ROAD WORK AREAS.
3. PROVIDE 4" LOAM, SEED, AND MULCH FOR TRENCHES IN NON-GRAVELED AND NON-PAVED AREAS.
4. 1" OF INSULATION IS EQUAL TO 1' OF COVER.

**WATER MAIN TRENCH DETAIL**

**(NOT TO SCALE)**

CITY OF BREWER
DETAILS
BREWER – MAINE

| | |
|---|---|
| DESIGNED BY: JPH | |
| DRAWN BY: JPH | |
| CHECKED BY: FBH | |
| DATE: JAN. 30, 2012 | |
| PROJECT NO.: 00-0000-00 | |
| FILE NAME: | |

**CITY OF BREWER**
**ENGINEERING DEPARTMENT**
221 GREENPOINT ROAD
BREWER, ME 04412
PHONE: 989-7800
FAX: 989-8024